

Solenoid Valve - 5/2 - Single Solenoid - Monostable

Benefits & Features


- Five way single solenoid valve
- Suitable for gaseous media
- High dependency applications
- Compact design
- Brass or 316 stainless steel bodies
- Ex-d IIC -60°C to +60°C ambient versions
- ATEX, EAC Ex (CU TR 012) and IECEx, Ex-d approved



Specification

Configuration	Internal pilot operation
Port Sizes	1/4" BSP or NPT
Orifice	7.0mm
Kv	see table below
Body	Brass or 316 stainless steel
Media	gaseous media, subject to material compatibility
Pressure ranges	3 - 10 Bar
Seals	NBR, VITON, HNBR

Configuration



D03.d Single Solenoid Monostable	
IN:	E
Coil De-energised:	From E to U1
	From U2 to S2
Coil Energised:	From E to U2
	From U1 to S1


Technical Data

	A	70	B	C	D	E	Port Size BSP or NPT	Body Rating	Orifice mm	Min. /Max. Operating Differential Pressures.			KV Flow Factor L/min.
										Min. BAR	Maximum BAR		
											AC	DC	
D03							¼"	10	7.0	3	10	10	12.5

Solenoid Valve - 5/2 - Single Solenoid - Monostable

Dimensions

Weight Kg	Dimensions mm							
	A	B	C	D	E	F	G	H
1.2	50	32	18	18	18	23	30	193

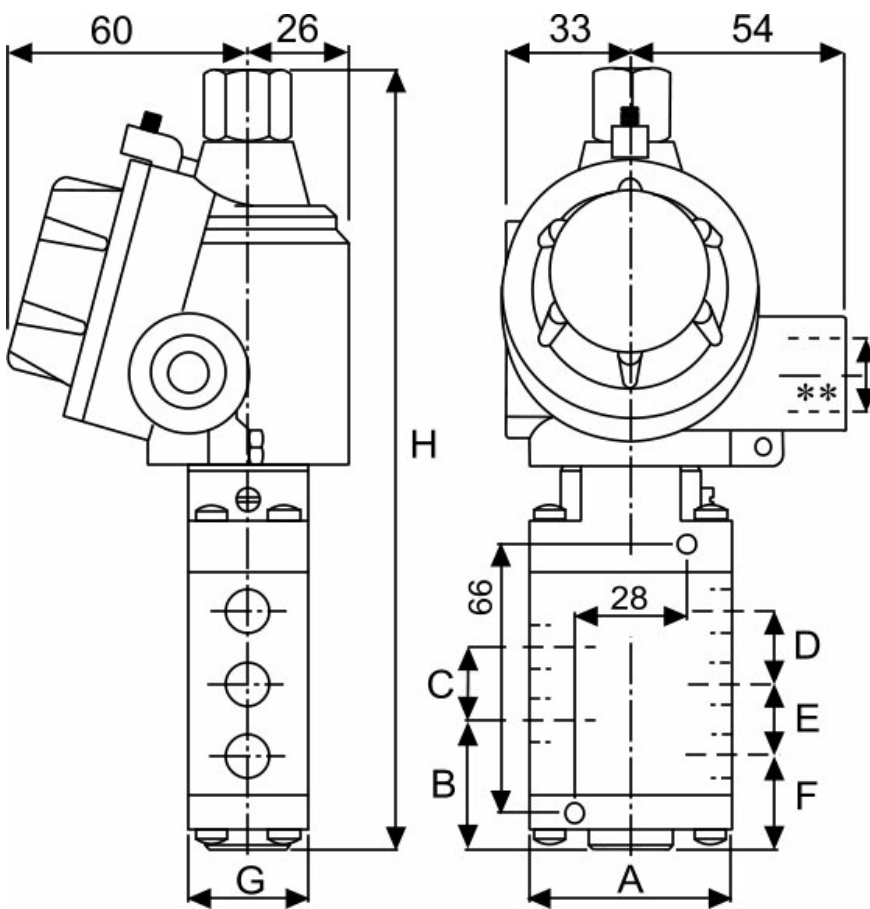


Order Codes

A	Body	B	Port	C	Seals (fluid temp. min / max)	D	Protection	E	Options		
T	Brass	C	1/4" BSP	D	1/4" NPT	0	NBR (-10°C to +70°C)	B	II 1/2 GD Ex-d IIB T6 (-20 to +40°C)	X	Manual Override
I	316 Stainless Steel					1	VITON (-10°C to +90°C)	C	II 1/2 GD Ex-d IIC T6 (-20 to +40°C)	/SG	Degreased for oxygen
						7	HNBR (-10°C to +90°C)	/LT	II 1/2 GD Ex-d IIC T6 (-60 to +60°C)		
								H	Ex-d c IIB IP67 IECEX		
								T	Ex-d c IIC IP67 IECEX		
								R	Ex-d IIC EAC Ex		
								S	IP67 (Safe Area)		


Electrical Wiring - IP67 Housing

Installation Procedures & Methods

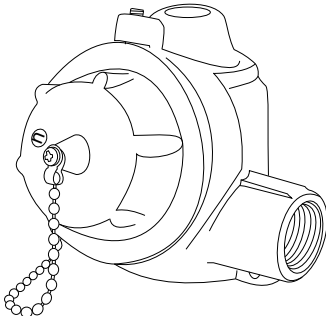


Attention: For safety purposes, always ensure that the power supply is disconnected. After de-energising, allow 15 minutes before continuing the following procedures


A

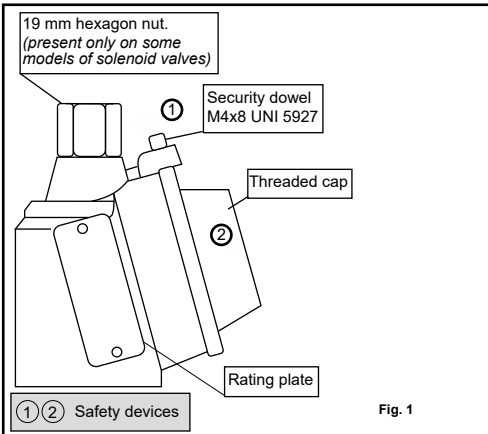

B

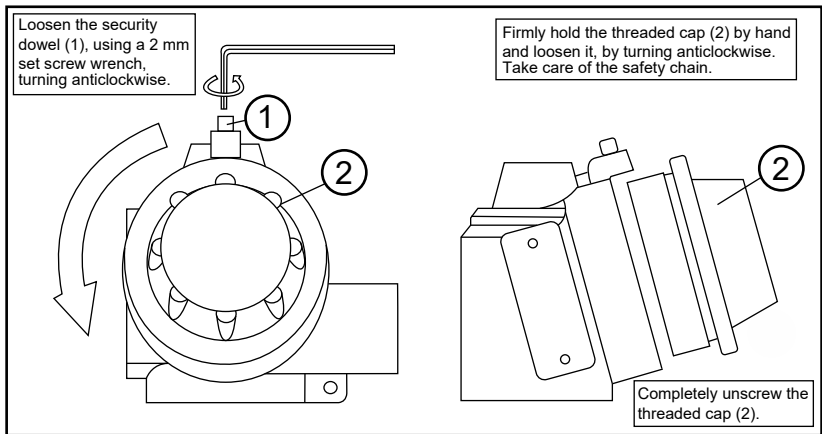

C

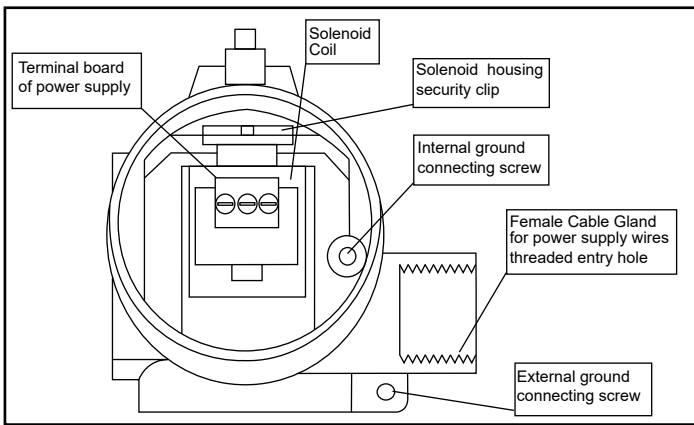

Pipe fittings used for cable entry (Cable, duct, conduit etc) are NOT supplied by the manufacturer. Installation engineers should ensure that the use of fittings are of the correct diameter and suitable to secure the tightness of the cable used. Where site conditions indicate, cable duct, conduit etc. must be ATEX approved, for a protection degree equal or greater than the protection degree indicated on the rating plate. The female thread type is indicated on the housing: M20*1.5mm or 1/2"NPT

D

